


- ① CONTRACTOR SHALL INSTALL BEND TO ACHIEVE 7.5' BURY, BEND SHALL NOT EXCEED 45°, ALL FITTINGS WILL BE PAID AS PER UNIT PRICE.



HYDRANT INSTALLATION Plate No. WS-2

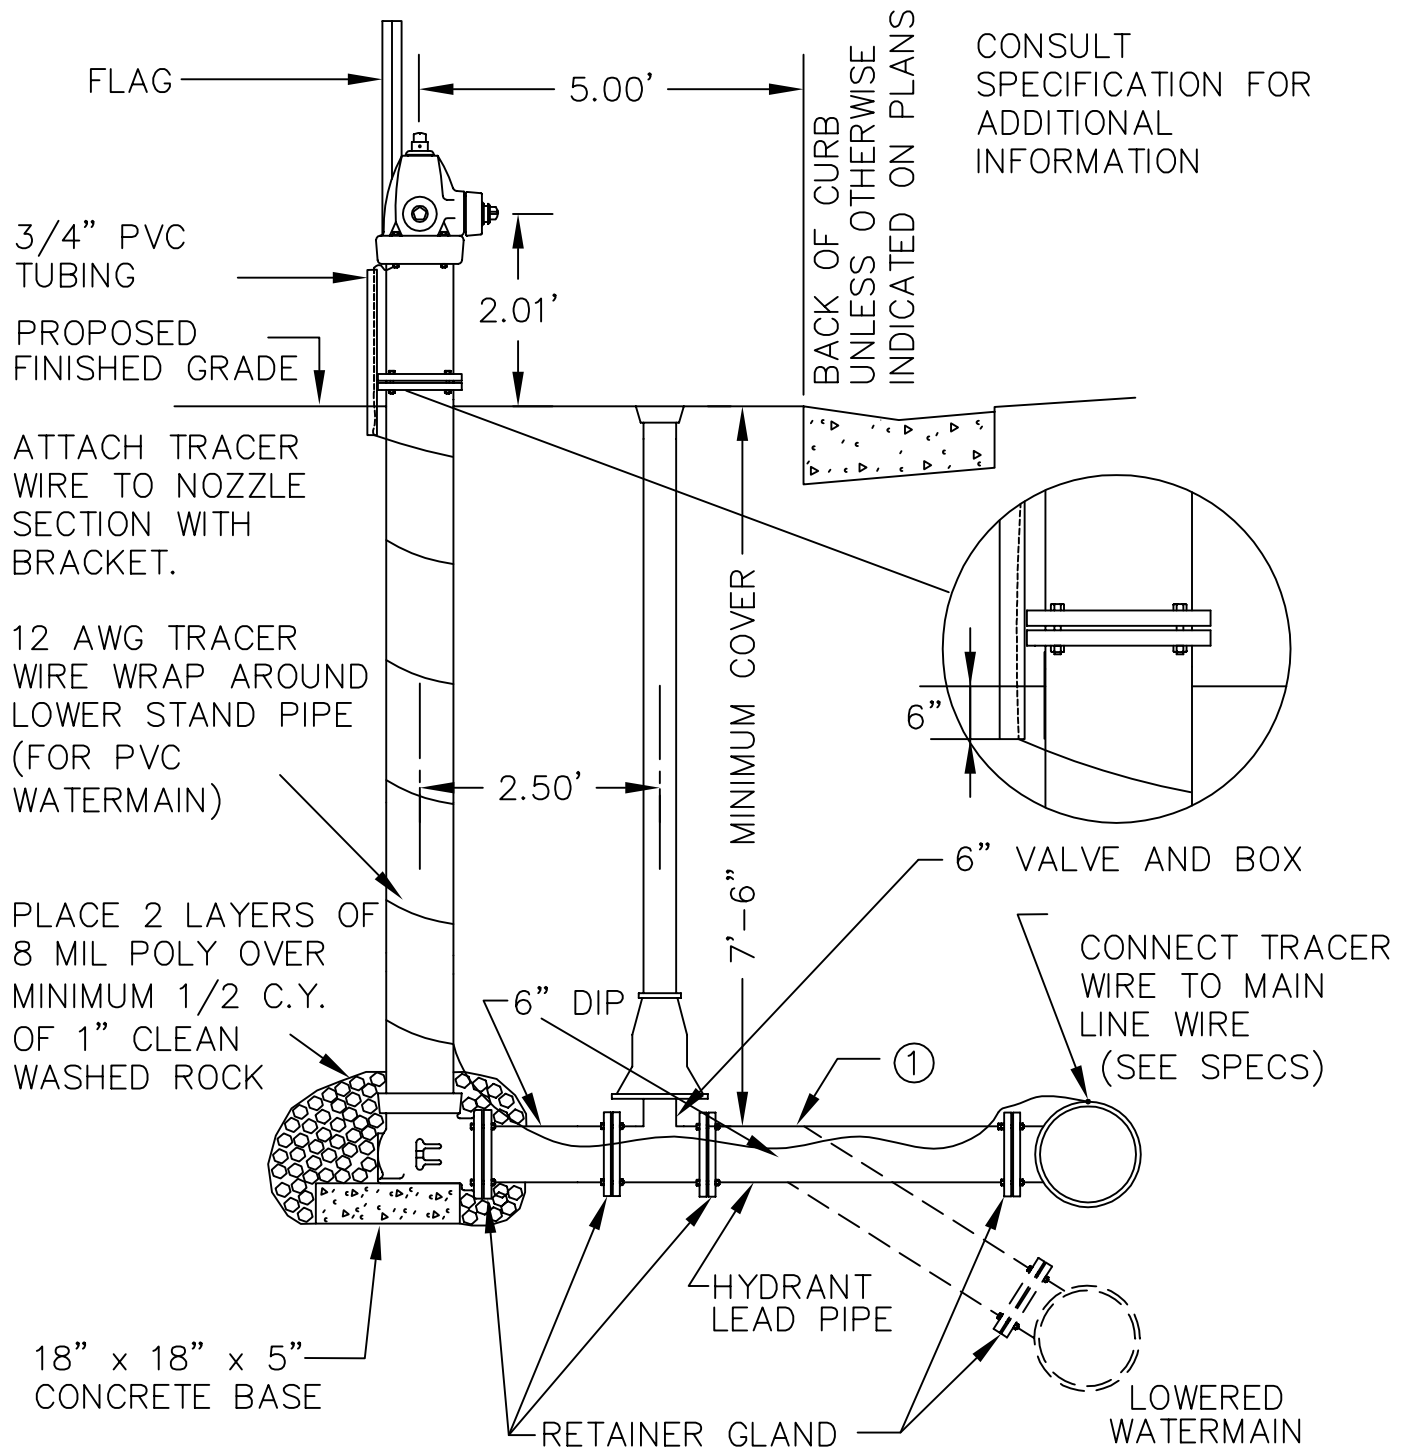

2014 STANDARD DETAIL PLATE

City of Blaine - Engineering Department

10801 Town Square Drive NE, Blaine, Minnesota 55449

(763)785-6172

Fax(763)785-6139